
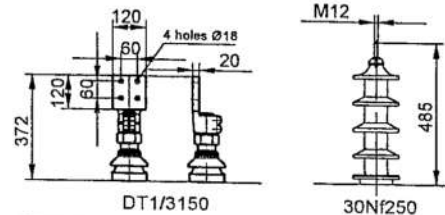


- 1) Oil Conservator
- 2) Magnetic Oil level indicator (without contact)
- 3) Dehydrating breather (G.D-603)
- 4) LV Bushing DT1/3150 (GD-333) (DIN 42530)
- 5) HV Bushing 30NF250 (GD-334) (DIN 42531)
- 6) Off circuit tap changer
- 7) Lifting lugs for complete transformer & active part
- 8) Terminal sheet
- 9) Rating Plate
- 10) Oil drain & down sampling device (DIN42551)
- 11) Earthing screw M12
- 12) Pulling lug $\phi 30$
- 13) Oil thermometer (with alarm & trip contacts)-R1"
- 14) Buchholz relay (with alarm and trip contacts)(DR25)
- 15) Wheels (angle for rotation 90°)(GD-502)
- 16) Filling cap for conservator
- 17) Drain for conservator

Voltage ratio: $33 \pm 2 \times 2.5\% / 0.4$ kV
 Vector group: Dyn1
 Frequency: 50 Hz
 Cooling method: ONAN
 Transformer color: RAL7032

Weights :
 Core & Winding : 1572 kg
 Untanking : 1945 kg
 Oil : 918 kg
 Total : 3883 kg

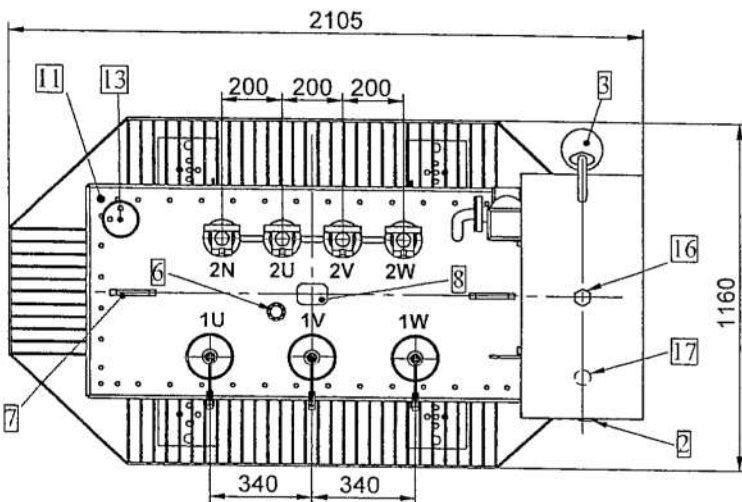

Comment : 1390/91 P 1399/1/19	Tolerances according to: DIN ISO 2768-C	Superficial Tolerances DIN ISO 1302	Ordered by زنگنه	Power 1250 kVA R30
	Date Dsgn 95.08.16 Cntrl 95.08.18 Appr 95.08.19	Name Azizkhani Azizkhani Afshari	Title Outline Drawing	Scale 1/23
	Kooshkan Transformers		Drawing no. KTD017928	Page 1/1
	Index Total weight Changes	Date 95.09.29	Name Azizkhani	Ref. no. KTB1383