


- 1) Oil Conservator
- 2) Magnetic Oil level indicator (without contact)(L=156)
- 3) Dehydrating breather (G.D-603)
- 4) LV Bushing R3/4500
- 5) HV Bushing 30NF/250 (GD-334) (DIN 42531)
- 6) Pulling lug $\varnothing 30$
- 7) Oil drain & down sampling device (DIN42551)
- 8) Earthing screw M12
- 9) Wheels (Angle for rotation 90°)(GD-502)
- 10) Off circuit tap changer
- 11) Oil thermometer (with alarm & trip contacts)-R1"
- 12) Lifting lugs for complete transformer and active part
- 13) Rating Plate
- 14) Buchholz relay (with alarm and trip contacts)(DR25)(DIN42566)
- 15) Drain for conservator
- 16) Terminal sheet
- 17) Filling cap for conservator

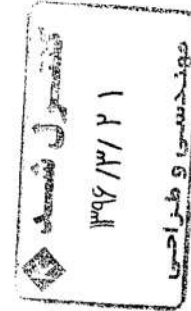

Weights :

Untanking :	2947 kg
Core & winding :	2396 kg
Oil :	1227 kg
Total :	5540 kg

Voltage ratio : $33 \pm 2 \times 2.5\% / 0.4$ kV
 Vector group : Dyn1
 Frequency : 50 Hz
 Cooling method : ONAN
 Transformer color : RAL7032

Comment :	Tolerances according to: DIN ISO 2768-C		Superficial Tolerances DIN ISO 1302		Ordered by نرمال بهینه	Power 2000 kVA R30
	%	Date	Name		Title Outline Drawing	Scale
	Dsgn	۳۱/۱۴	Abadi		Drawing no. KTD019340	1:27
	Cntrl	۳۱/۱۷	Yarosh			
	Appr	۳۱/۱۷	Yarosh		Ref. no. KTBI467	Page 1/1
Index	Changes	Date	Name	Appr		