



Kooshkan Transformers




# Outline Drawing

Technical Office

No: TOT002641

Opt: 03

Date: 95.06.14

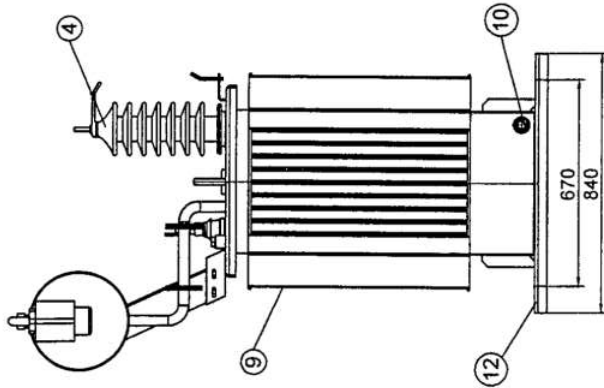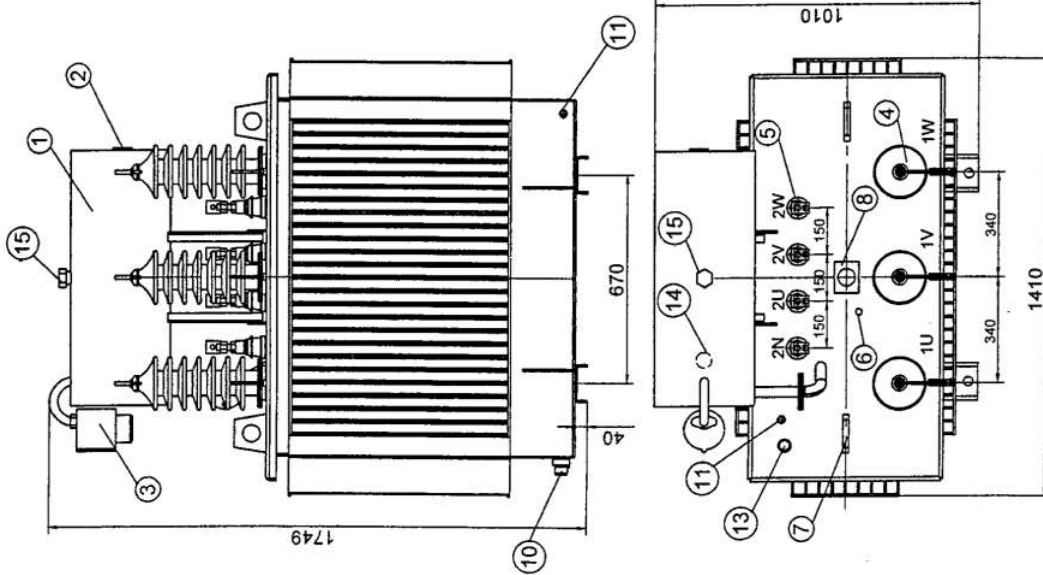

- 1) Oil Conservator
- 2) Magnetic Oil level indicator (without contact)
- 3) Dehydrating breather
- 4) HV Bushing 33/250-900
- 5) LV Bushing DT1/630 (DIN 42530)
- 6) Off circuit tap changer
- 7) Lifting lugs for complete transformer and active part
- 8) Terminal sheet
- 9) Rating plate
- 10) Oil drain and down sampling device (DIN 42551)
- 11) Earthing screw M12
- 12) Pulling lug  $\phi$  30
- 13) Oil thermometer pocket
- 14) Drain for conservator
- 15) Filling cap for conservator

Weights

Untanking :	900 kg
Oil :	399 kg
Total :	1525 kg

Rating Power: 315 KVA  
Voltage Ratio: 33/0.4 KV  
Tender: Low Loss-AB'

Comment: Paint: RAL 7032

\* Dimensions and weights are approx.

Design: *Rikael*

Date : 89.04.22

Prep. No. : 1

25.6.14

Control: *Shoj*

95.6.14

Approval: *Shoj*

25.6.14

08-KF-02

Doc. Prep. Cen.